

This manual covers the following models:

• T755

# **Thermostat Applications Guide**

Description	
Gas or Oil Heat	Yes
Electric Furnace	Yes
Heat Pump (No Aux. or Emergency Heat)	Yes
Heat Pump (with Aux. or Emergency Heat)	Yes
Multi-stage Systems	Yes
Heat Only Systems	Yes
Cool Only Systems	Yes
Millivolt	Yes

# **Power Type**

Battery Power
Hardwire (Common Wire)
Hardwire (Common Wire) with Battery Backup

Table of Contents	Page
Installation Tips	2
Thermostat Quick Reference	3
Subbase Installation	4
Wiring	5-6
Technician Setup Menu	7-9
Mounting and Battery Installation	10
Programming The Thermostat	11-12
Specifications	13

Una versión española de este manual puede ser descargada en www.pro1iaq.com

# A trained, experienced technician must install this product.


Carefully read these instructions. You could damage this product or cause a hazardous condition if you fail to follow these instructions.

# **Need Help?**

For assistance with this product please visit http://www.pro1iaq.com or call Pro1 Customer Care toll-free at 888-Pro1iaq (776-1427) during normal business hours (Mon-Fri 9 AM - 6 PM Eastern)

#### **Wall locations**

The thermostat should be installed approximately 4 to 5 feet above the floor. Select an area with average temperature and good air circulation.

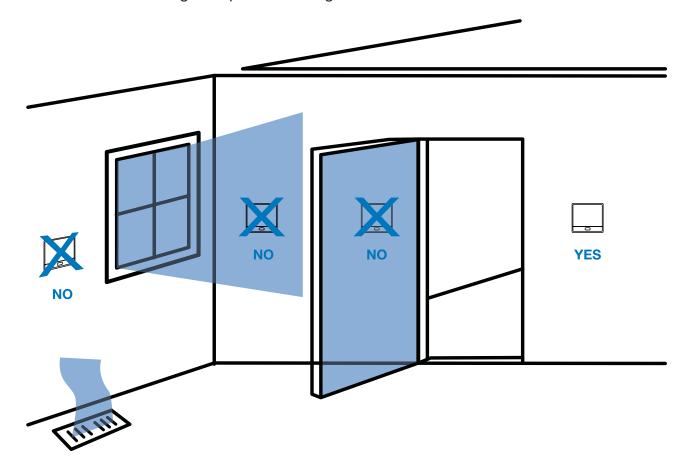

#### **Do not install** thermostat in locations:

- Close to hot or cold air ducts
- That are in direct sunlight
- With an outside wall behind the thermostat
- In areas that do not require conditioning
- Where there are dead spots or drafts (in corners or behind doors)
- Where there might be concealed chimneys or pipes
- Where appliances could radiate heat

#### **PRO1 Tip**


Pick an installation location that is easy for the user to access.

The temperature of the location should be representative of the building.

# THERMOSTAT QUICK REFERENCE

## Getting to know your thermostat



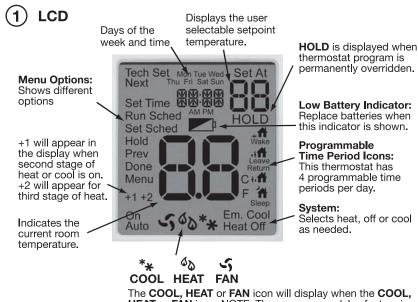

- ② Glow in the Dark Light Button
- (3) Fan Button
- 4 System Button
- 5 User Program Buttons
- 6 Temperature Setpoint Buttons
- 7 Battery Door
- 8 Universal Private Label Badge




# **Important:**

The low battery indicator is displayed when the AA battery power is low. If the user fails to replace the battery within 21 days, the thermostat display will only show the low battery indicator as a final warning before the thermostat becomes inoperable. The batteries are located on the front of the thermostat.

turn on until the 5 minute delay has elapsed.

**HEAT** or **FAN** is on NOTE: The compressor delay feature is active if these icons are flashing. The compressor will not

# Removing the private label badge

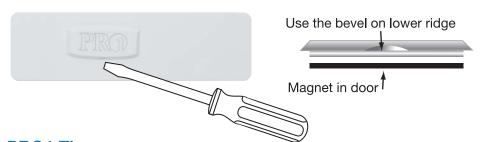

Gently slide a screwdriver into the bottom edge of the badge. Gently turn the screwdriver counter clockwise. The badge is held on by a magnet. The badge should pry off easily. **Do not use force.** 

PRO1 Tip

All Pro1 thermostats use the same universal magnetic badge.

Visit our website at www.pro1iaq.com to learn more about our free private label program.

# **SUBBASE INSTALLATION**




# Caution: Electrical Hazard

Failure to disconnect the power before beginning to install this product can cause electrical shock or equipment damage.



# **Mercury Notice:**

All of Pro1's products are mercury free. However, if the product you are replacing contains mercury, dispose of it properly. Your local waste management authority can give you instructions on recycling and proper disposal.

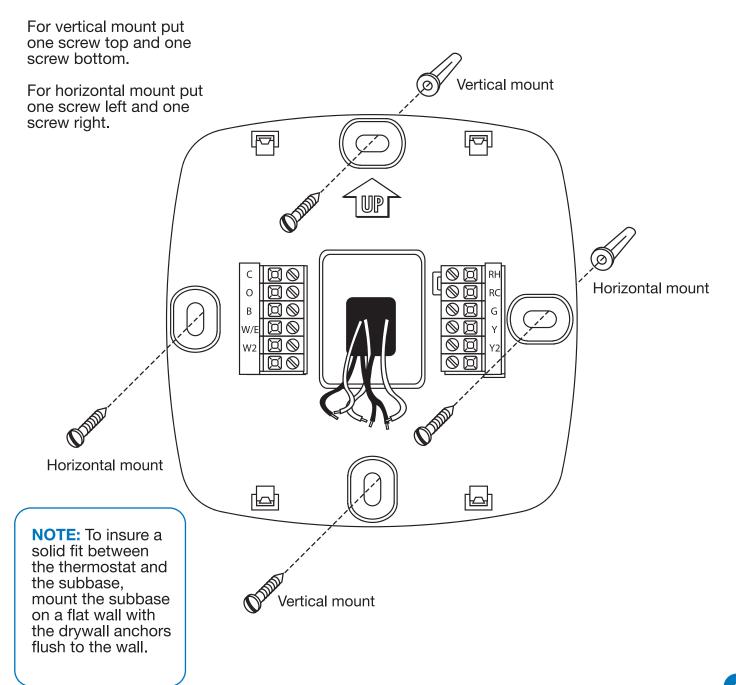

# **New Thermostat Installation Wiring**


A Power supply.

Factory-installed jumper. Remove only when installing on 2-transformer systems.


Use either O or B terminals for changeover valve.

A Optional 24 VAC common connection when thermostat is used in battery power mode.


### **Typical 2H/2C system: 1 transformer**

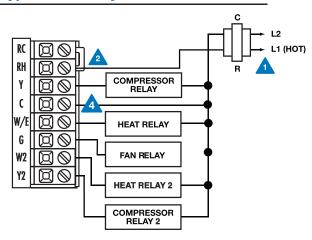


#### Typical 2H/2C system: 2 transformer

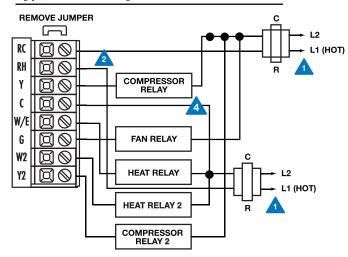


#### Typical 3H/2C heat pump system

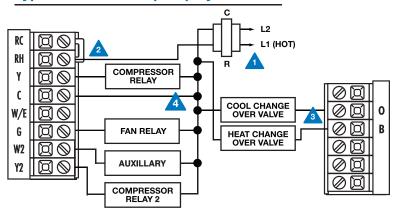


# **Typical heat-only system**

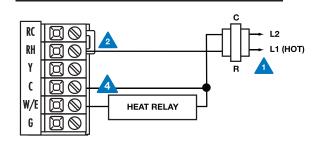

#### Typical heat-only system with fan

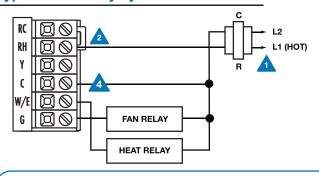

#### Typical cool-only system

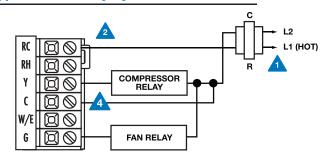

NOTE: In many systems with no emergency heat relay a jumper can be installed between E and W2.

## **Wiring**

- 1. If you are replacing a thermostat, make note of the terminal connections on the thermostat that is being replaced. In some cases the wiring connections will not be color coded. For example, the green wire may not be connected to the **G** terminal.
- 2. Loosen the terminal block screws. Insert wires then retighten terminal block screws.
- 3. Place nonflammable insulation into wall opening to prevent drafts.
- 4. Push wire into the wall so the thermostat can mount securely to the subbase.



# Warning:

All components of the control system and the thermostat installation must conform to Class II circuits per the NEC Code.

## Wire specifications

Use shielded or non-shielded 18 - 22 gauge thermostat wire.

## **Terminal Designations**

This thermostat is shipped from the factory to operate a conventional heating and cooling system. This thermostat will also operate a heat pump system. See the "heat pump" configuration step on page 8 of this manual to configure the thermostat for heat pump applications.

Terminal	2 Heat 2 Cool Conventional System	2 Heat 2 Cool Heat Pump System	3 Heat 2 Cool Heat Pump System
RC	Transformer power (cooling)	Transformer power (cooling)	Transformer power (cooling)
RH	Transformer power (heating)	Transformer power (heating)	Transformer power (heating)
С	Transformer common (For 2 transformer systems, use RH common.)	Transformer common	Transformer common
В	Energized in heating	Heat pump changeover valve energized in heating	Heat pump changeover valve energized in heating
0	Energized in cooling	Heat pump changeover valve energized in cooling	Heat pump changeover valve energized in cooling
G	Fan relay	Fan relay	Fan relay
W/E	First stage of heat	Emergency heat relay	Emergency heat relay
W2	Second stage of heat	Auxiliary heat relay, second stage of heat	Auxiliary heat relay, third stage of heat
Y	First stage of cool	First stage of heat & cool	First stage of heat & cool
Y2	Second stage of cool	Second stage of cool	Second stage of cool & second stage of heat

# **PRO1 Tips:**

#### C terminal

The **C** (common wire) terminal does not have to be connected when the thermostat is powered by batteries.

#### Note:

In many systems with no emergency heat relay a jumper can be installed between E and W2.

# **TECHNICIAN SETUP MENU**

## **Technician Setup Menu**

This thermostat has a technician setup menu for easy installer configuration. To set up the thermostat for your particular application:

- 1. Press **MENU** button
- 2. Press and hold **TECHNICIAN SETUP** button for 3 seconds. This 3 second delay is designed so that homeowners do not accidentally access the installer settings.
- 3. Configure the installer options as desired using the table below.

Use the \_\_\_\_ or \_\_\_ keys to change settings and the **NEXT STEP** or **PREV STEP** key to move from one option to another. **Note:** Only press **DONE** key when you want to exit the Technician Setup options.

#### **Tech Setup Steps** Filter Room Minimum Cooling Compressor Heating Compressor . Change **Temperature** Short Cycle Delay Swing Swing Reminder Calibration On Time This feature will flash This feature allows This feature allows the The compressor short The swing setting, often The swing setting, often called "cycle rate", FILT in the display the installer to change installer to select the cycle delay protects the called "cycle rate". after the elapsed run the calibration of the minimum run time for compressor from "short "differential" or "differential" or "anticipation" is adjustable. A smaller "anticipation" is adjustable. A smaller time to remind the room temperature the compressor. cycling". This feature will display. For example, user to change the For example, a setting of not allow the compressor filter. A setting of OFF will disable this 4 will force the to be turned on for 5 swing setting will cause if the thermostat swing setting will cause reads 70° and you more frequent cycles and compressor to run for at minutes after it was last more frequent cycles and feature. would like it to read least 4 minutes every turned off. a larger swing setting will a larger swing setting 72° then select +2. will cause fewer cycles. time the compressor cause fewer cycles. turns on, regardless of the room temperature. **LCD Will Show** COOF CO COUL []F ERL HELL Prev Done **Adjustment Options** You can adjust the You can adjust the The cooling swing setting is adjustable The heating swing setting is adjustable You can select the Selecting ON will not filter change room temperature minimum compressor allow the compressor to display to ready -4°F run time from "off", "3", "4", or "5" minutes. If 3, 4, or 5 is selected, from ±0.2°F to ±2°F. reminder from OFF be turned on for 5 from ±0.2°F to ±2°F. to +4°F above or to 2000 hours of For example: A swing setting of 0.5°F will turn For example: A swing setting of 0.5°F will minutes after the last runtime in 50 hour below the factory time the compressor was increments. calibrated reading. the compressor will run on. Select OFF to the cooling on at turn the heating on at approximately 0.5°F for at least the selected remove this delay. approximately 0.5°F above the setpoint and time before turning off. below the setpoint and turn the heating off at turn the cooling off at approximately 0.5°F below the setpoint. approximately 0.5°F above the setpoint. **Factory Default Settings** 0 ºF 0.5 ºF **OFF OFF** ON 0.4 ºF

Note: To lock the keypad hold down the + and - keys for 3 seconds. You will see a lock in the display. To unlock the keypad hold down the + and - keys for 3 seconds.



# **TECHNICIAN SETUP MENU**

setpoint value. The setpoint temperature cannot be raised above this value.  Setpoint temperature this value.  Setpoint temperature cannot be lowered below this value.  WAKE programming time to ensure the enviroment is at the WAKE setpoint when the WAKE time period  WAKE programming or select C for Celsius read out read out  Select C for Celsius read out  From Normalizer the fan during a call for heat.  Select ELEC to have the WAKE time period	Heating Temperature Setpoint Limit	Cooling Temperature Setpoint Limit	Morning Recovery	ºF or ºC	12 or 24 Hour Clock	Fan Operation
MORN OF HELM SO  COLM 44  Prev Done  Next FORC OF Prev Done  Or Of For Fahrenheit Rey to select the minmum cool setpoint.  Use the + or - key to select the minmum cool setpoint.  Or Of Or Office Sius  Next FORC OF Prev Done  Next FORC OF Prev Done  Or Office Sius  Or Office Siu	to set a maximum heat setpoint value. The setpoint temperature cannot be raised above	to set a minimum cool setpoint value. The setpoint temperature cannot be lowered below	system on before the WAKE programming time to ensure the enviroment is at the WAKE setpoint when the WAKE time period begins. This recovery changes over time based on the previous	temperature read out or select C for Celsius	12 or 24 hour clock	systems that control the fan during a call for heat.  Select ELEC to have the thermostat control the fan during
Use the + or - key to select the minmum cool setpoint.  Use the + or - key to select the minmum cool setpoint.  Use the + or - key to relative to real the minmum cool setpoint.  Use the + or - key to real the minmum cool setpoint.  Use the + or - key to real the minmum cool setpoint.  Use the + or - key to real the minmum cool setpoint.  Use the + or - key to real the minmum cool setpoint.  Use the + or - key to real the minmum cool setpoint.	Prev Done	HELM <b>90</b>	COLM <b>-( -(</b>	FORC <b>W</b>	CLOK ic	F AN <b>biri</b>
	Use the + or - key to select the maximum	key to select the minmum			key to select 12 or 24	or



# **PRO1 Tip**

The second stage will turn on at 2x the swing setting. The second stage will turn off when 1x the swing is reached. For example, if the swing setting is .8 degrees for heating and the thermostat is set at 70°F, the first stage will turn on at approximately 69.2°F. The second stage will turn on at 68.4°F. The second stage will turn off at 69.2°F and the first will turn off at 70.8°F. If third stage is used, it will turn on at 3x the swing and turn off at approximately 2x the swing.

# TECHNICIAN SETUP MENU

his thermostat to the nave a 5+1+1 congram or non-programmable.	When turned on the thermostat will operate a heat pump.  1. EM.Heat will show as an option in the system switch.  2. Y will be first stage of heat & cool, W/E will be emergency heat relay & W2 will be	You can configure the system switch for the particular application: Heat - Off - Cool, Heat - Off, Cool - Off, Note: EM. Heat will show if in heat pump	This option will turn the heat pump off 45 seconds after the auxiliary heat relay turns on.	a 3 stage heat pump system.	setting will delay the fan from coming on in cool mode and keep	This feature allows the thermostat to keep multiple stages of heat or cool	This feature allows a delay to occur when a second and
r	auxiliary heat relay.	mode.	For 2 heat applications, the first stage will turn off 45 seconds after the auxiliary stage turns on.  For 3 heat applications, the first and second stage will turn off 45 seconds after the auxiliary stage turns on.	3H = 3 heat, 2 cool	running after the compressor shuts off for a short time to save energy in some systems.	energized until setpoint is satisfied.	third stage needed. This allows the previous stage extr time to satisfy setpoint.
LCD Will Show							
Prev Done	Prev Done	Prev Done  Cool Heat Off	Prev Done	Next HEST 2H	Prev Done	Next 5d OF Prev Done	Prev Done
Adjustment Options							
key 5d for 5+1+1, for 0d for some some some some some some some some	OFF configures the thermostat for non heat pump systems ON configures the thermostat for heat pump systems	Use the + or - key until the desired application is flashing.	For heat pump systems that are "dual fuel" (use a gas furnace for auxiliary stage heat) you can turn this feature on to turn off the heat pump when the auxiliary stage of heating has called for.	Use the + or - key to change between 2 heat and 3 heat.  2 heat will use Y1 as first stage and W2 as auxiliary.  3 heat will use Y1 as first stage, Y2 as second stage and W2 as auxiliary.	You can select the Cooling Fan Delay from "Off", "15", "30", "60" or "90" seconds. If 15, 30, 60 or 90 is selected the fan will not turn on for that many seconds whenthere is a call for cooland will run for that many seconds after satisfying a call for cool.	Use the + or - key to turn on or off.	Use the + or - key to select OFF, 5, 10, 15, 30, 45, 60, 90.
Factory Default Settings  5d	OFF	Heat - Off - Cool	OFF	2 Stages	OFF	OFF	OFF

# **MOUNT THERMOSTAT & BATTERY INSTALLATION**

#### **Mount Thermostat**

Align the 4 tabs on the subbase with corresponding slots on the back of the thermostat, then push gently until the thermostat snaps in place.


Note: To insure a solid fit between the thermostat and the subbase:

- 1. mount subbase to flat wall
- 2. use screws provided
- 3. drywall anchors should be flush with the wall
- 4. wires should be pushed into the wall



## **Battery Installation**

Battery installation is optional if thermostat is hardwired (**C** terminal connected).

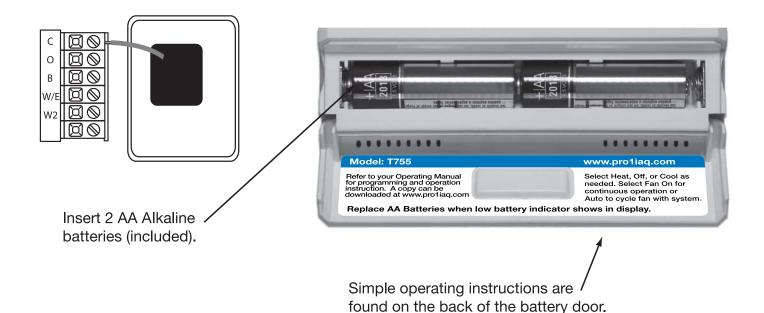

# PROGRAMMING THE THERMOSTAT

#### **Set Time**

Follow the steps below to set the day of the week and current time:

- 1. Press MENU
- 2. Press SET TIME
- 3. Day of the week will be flashing. Use the + or key to select the current day of the week.
- 4. Press **NEXT STEP**
- 5. The current hour is flashing. Use the \_\_\_\_ key to select the current hour. When using 12-hour time, make sure the correct a.m. or p.m. choice is selected.
- 6. Press **NEXT STEP**
- 7. Minutes are now flashing. Use the + or key to select current minutes.
- 8. Press **DONE** when completed

### **Programming**

All programmable Pro1 thermostats are shipped with an energy saving pre-program. You can customize this default program by following the Set Program Schedule.

Your thermostat can be programmed to have all the weekdays the same, a separate program for Saturday, and a separate program for Sunday. There are four time periods for each program (WAKE, LEAVE, RETURN, SLEEP).

		Factory Defa	ult Program	
Day of the Week	Events	Time	Setpoint Temperature (Heat)	Setpoint Temperature (Cool)
Weekday	Wake 🕍	6 a.m.	70° F (21° C)	75° F (24° C)
	Leave 4	8 a.m.	62° F (17° C)	83° F (28° C)
	Return i	6 p.m.	70° F (21° C)	75° F (24° C)
	Sleep 🗡	10 p.m.	62° F (17° C)	78° F (26° C)
Saturday	Wake 🕍	8 a.m.	70° F (21° C)	75° F (24° C)
	Leave 4	10 a.m.	62° F (17° C)	83° F (28° C)
	Return i	6 p.m.	70° F (21° C)	75° F (24° C)
	Sleep 🗡	11 p.m.	62° F (17° C)	78° F (26° C)
Sunday	Wake 🕌	8 a.m.	70° F (21° C)	75° F (24° C)
	Leave 4	10 a.m.	62° F (17° C)	83° F (28° C)
	Return i	6 p.m.	70° F (21° C)	75° F (24° C)
	Sleep 🕌	11 p.m.	62° F (17° C)	78° F (26° C)

# PROGRAMMING THE THERMOSTAT

You can use the table below to plan your customized program schedule if using 5+1+1.

		Programm	ing Table	
Day of the Week	Events	Time	Setpoint Temperature (Heat)	Setpoint Temperature (Cool)
Weekday	Wake 🕍			
	Leave (iff			
	Return +			
	Sleep 📸			
Saturday	Wake 🕍			
	Leave (iff			
	Return +			
	Sleep 👚			
Sunday	Wake 🕌			
	Leave 4111			
	Return in the			
	Sleep 👚			

Set	<b>Program</b>	Schedule	•
-----	----------------	----------	---

To customize your 5+1+1 program schedule, follow these steps Weekday:

- Select HEAT or COOL using the SYSTEM key. Note: You have to program heat and cool each separately.
- 2. Press MENU
- 3. Press **SET SCHED**. Note: Monday-Friday is displayed and the **WAKE** icon is shown. You are now programming the **WAKE** time period for the weekday setting.
- 4. Time is flashing. Use the + or key to make your time selection for the weekday **WAKE** time period. Note: If you want the fan to run continuously during this time period, select **ON** with the **FAN** key.
- 5. Press **NEXT STEP**
- 6. The setpoint temperature is flashing. Use the + or key to make your setpoint selection for the weekday **WAKE** period.
- 7. Press **NEXT STEP**
- 8. Repeat steps 4 through 7 for weekday **LEAVE** time period, for weekday **RETURN** time period, and for weekday **SLEEP** time period.

### Saturday:

 Repeat steps 4 through 7 for Saturday WAKE time period, for Saturday LEAVE time period, for Saturday RETURN time period, and for Saturday SLEEP time period.

# Sunday:

 Repeat steps 4 through 7 for Sunday WAKE time period, for Sunday LEAVE time period, for Sunday RETURN time period, and for Sunday SLEEP time period.

# A Note About Programmable Fan:

The programmable fan feature will run the fan continuously during any time period it is programmed to be on. This is the best way to keep the air circulated and to eliminate hot & cold spots in your building.

# **SPECIFICATIONS & CONTACT INFORMATION**

# **Specifications**

The display range of temperature	41°F to 95°F (5°C to 35°C)
The control range of temperature	44°F to 90°F (7°C to 32°C)
Load rating	1 amp per terminal, 1.5 amp maximum all terminals combined
Display accuracy	± 1°F
Swing (cycle rate or differential)	Heating is adjustable from 0.2°F to 2.0°F
	Cooling is adjustable from 0.2°F to 2.0°F
Power source	18 to 30 VAC, NEC Class II, 50/60 Hz for hardwire (common wire)
	Battery power from 2 AA Alkaline batteries
Operating ambient	32°F to +105°F (0° to +41°C)
Operating humidity	90% non-condensing maximum
Dimensions of thermostat	4.7"W x 4.4"H x 1.1"D

## **Contact Us**

## **Pro1 IAQ Inc.**

1111 S. Glenstone Suite 2-100 Springfield, MO 65804

**Toll-free:** 1-888-Pro1iaq (776-1427)

Toll Number (Outside the USA): 330-821-3600

Web: http://www.pro1iaq.com

Hours of Operation: Monday - Friday 9 AM - 6 PM Eastern